

Fermax 2049



See Connection Diagrams
Below

IMPORTANT NOTE :

1) Before replacing the handset make note of the wires to each terminal on the existing unit (an easy way is to cut each core off leaving a piece of the insulation in place with colour visible) twist unused cores together (so you know they are not used, do not short them out).

2) Some older systems will have cable with one coloured core and a solid white core in this case mark each core with a marker or tape.

3) Some systems may have loop on wiring, you will have 2 cables into your handset (make sure any joins remain, as these may be serving other flats on the system).

Wiring Diagram

1 Button Panel and 4 intercommunicating handsets


FERMAX
Cod.94247 V 02/02

ALIMENTADOR CAMBIADOR MULTILINEAS / MULTIWAY SWITCHER POWER SUPPLY
Ref. 8805 / Ref. 8806 / Ref. 8807 / Ref. 8808



Este Alimentador Cambiador Multilíneas sólo funciona con teléfonos City TN-4 (Ref. 2049), TN-8 (Ref.2051) y Monitores VP-8 (Ref. 4132) .
This Multiway Switcher Power Supply only works with City TN-4 (Ref. 2049), TN-8 (Ref.2051) Telephones and VP8 (Ref. 4132) Monitors.

Instalación con Teléfonos TN-4 / Installation with TN-4 Telephones

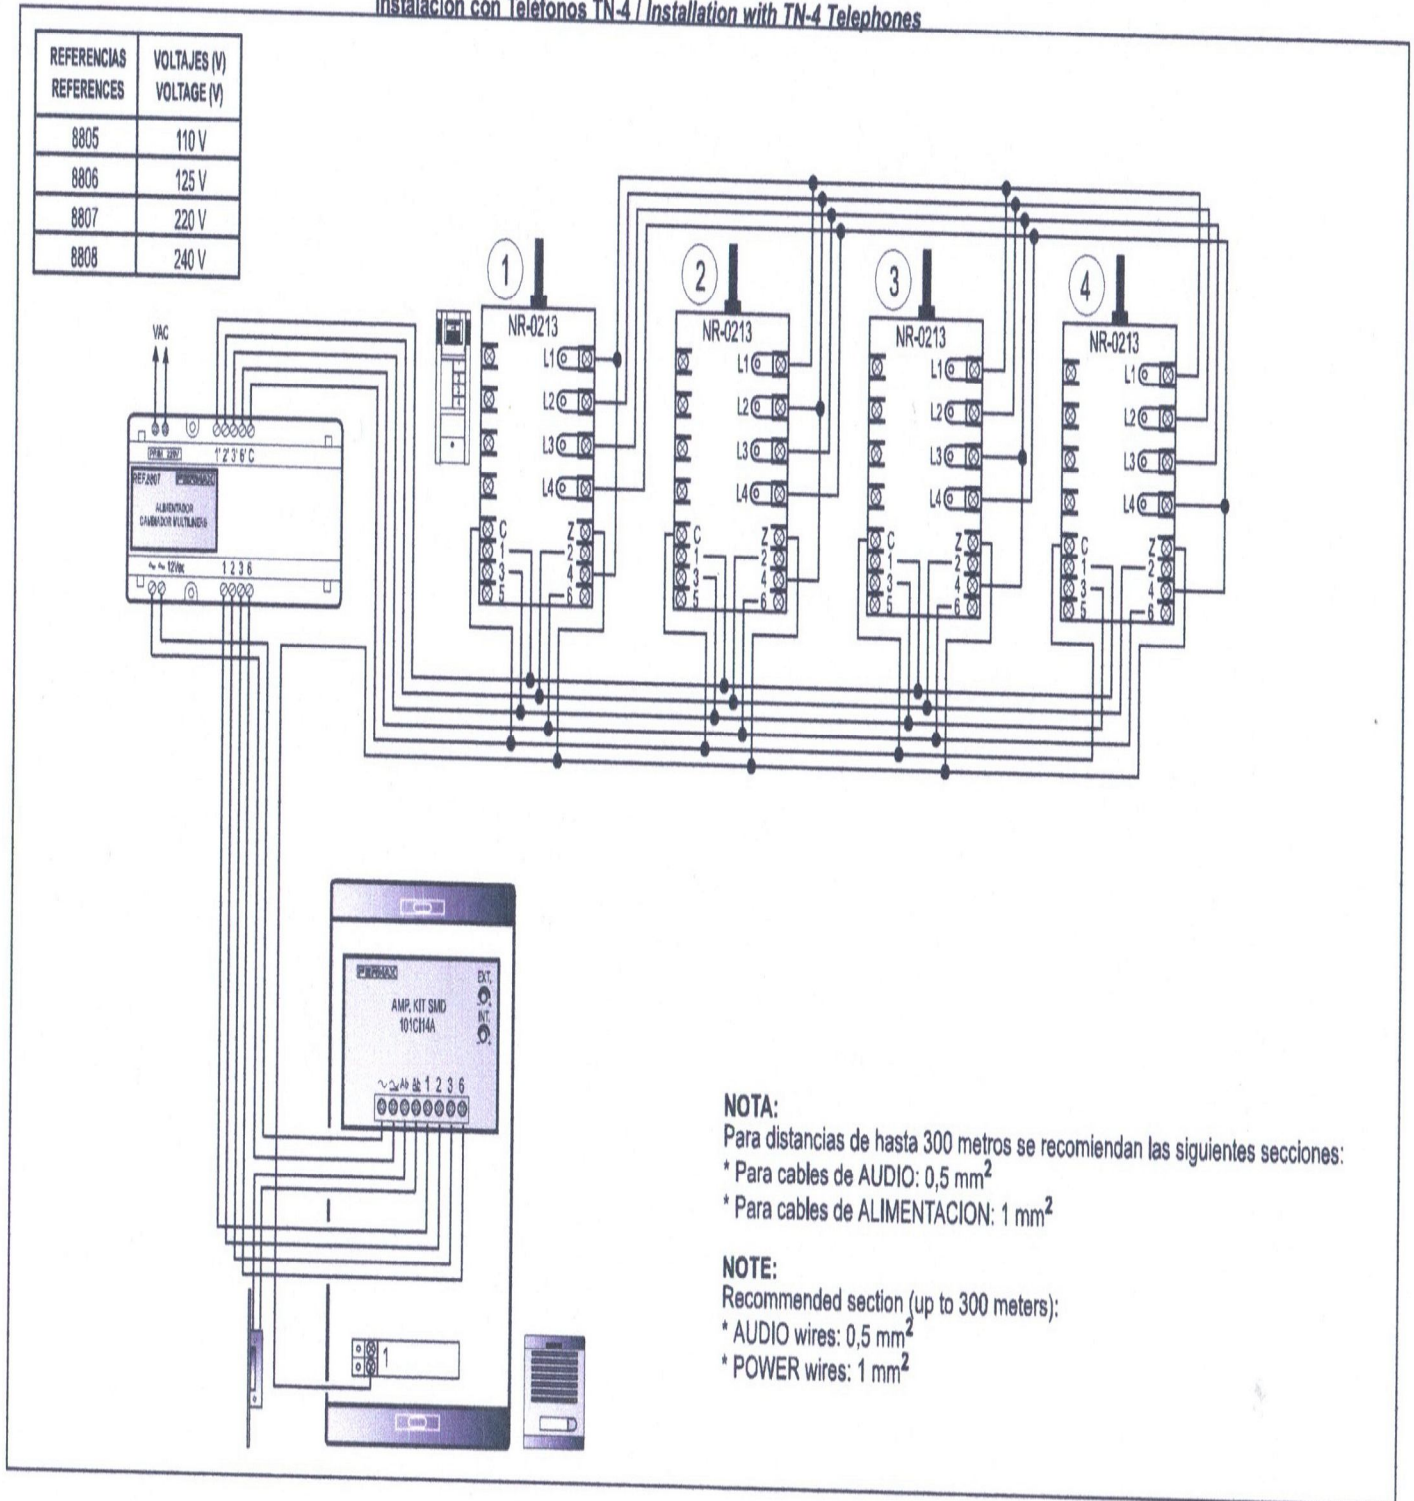

Wiring Diagram

1 Button Panel and 8 intercommunicating handsets

FERMAX
Cod.94247 V 02/02

ALIMENTADOR CAMBIADOR MULTILINEAS / MULTIWAY SWITCHER POWER SUPPLY
Ref. 8805 / Ref. 8806 / Ref. 8807 / Ref. 8808



Instalación con Teléfonos TN-8 / Installation with TN-8 Telephones

